


# Electric Meter Report

Generated on 22-Apr-19 6:00 AM IST

Electricity Consumption of Sunday, 21 April 2019


## Daily Real Power Total Chart - Main Meter

252.5 kW (Avg) | 408.2 kW (Max) | 92.4 kW (Min)

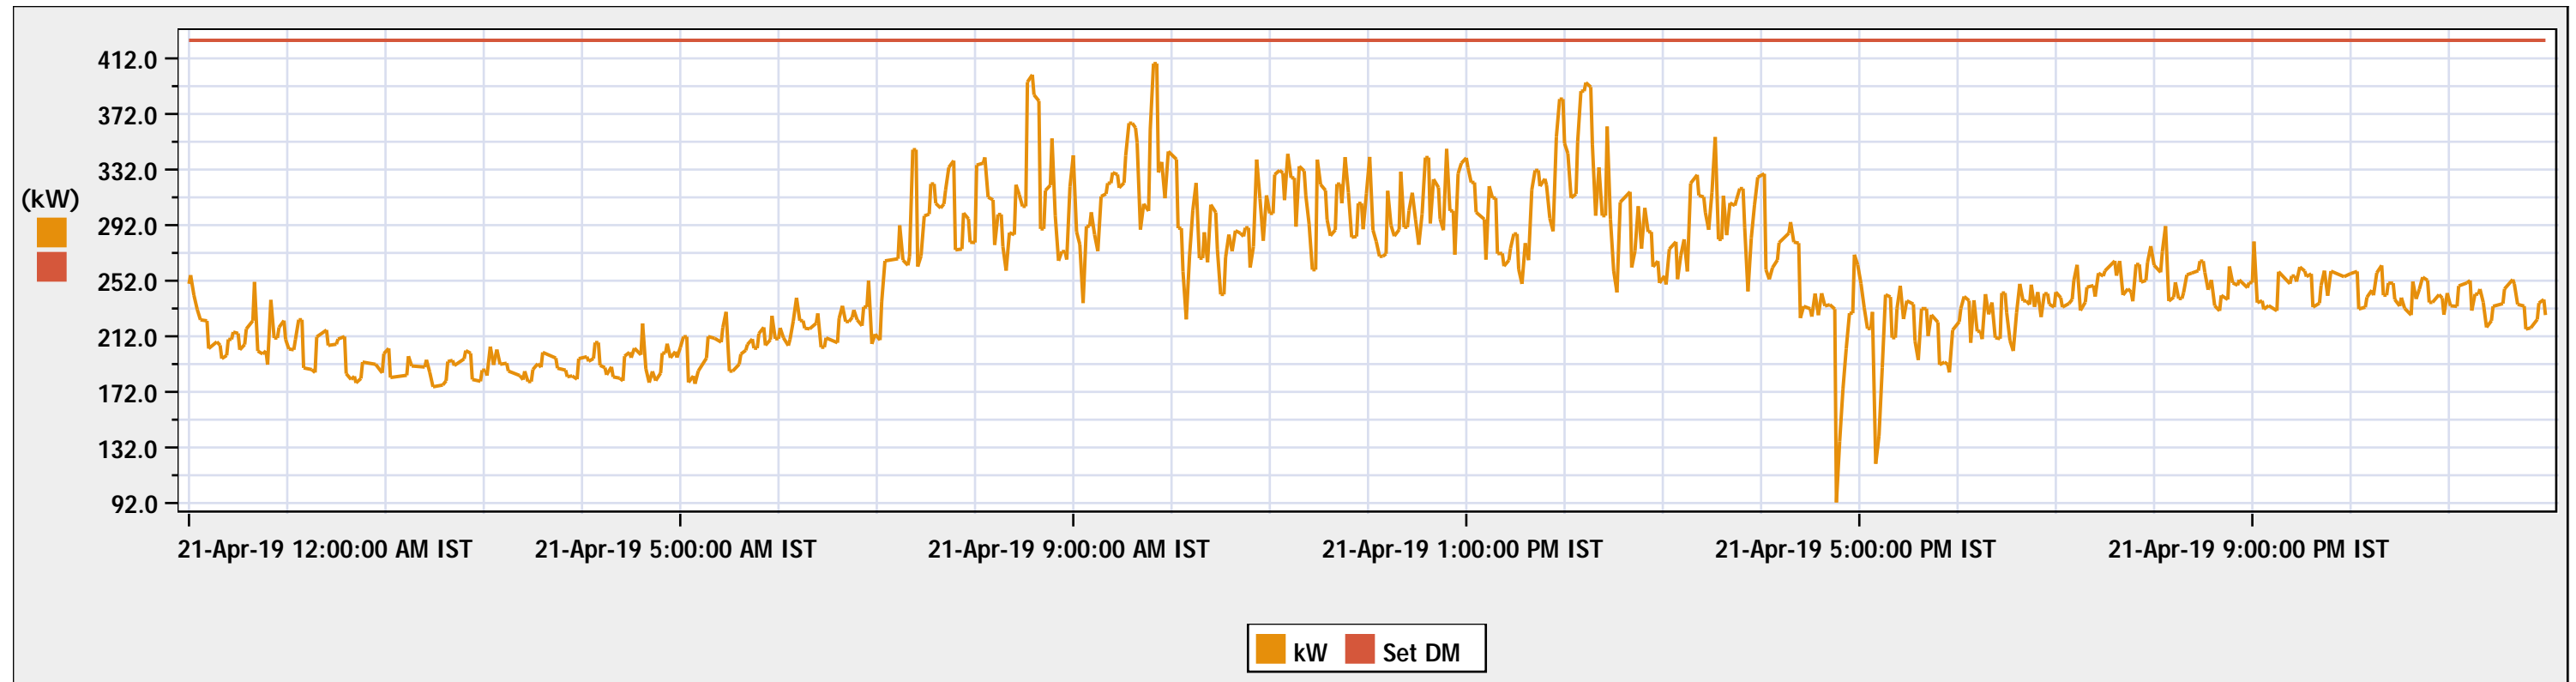

## Daily Energy Consumption Chart - Main Meter

Energy Consumption 6076.2 kW-hr | 45571.88 INR (Rate 7.50)

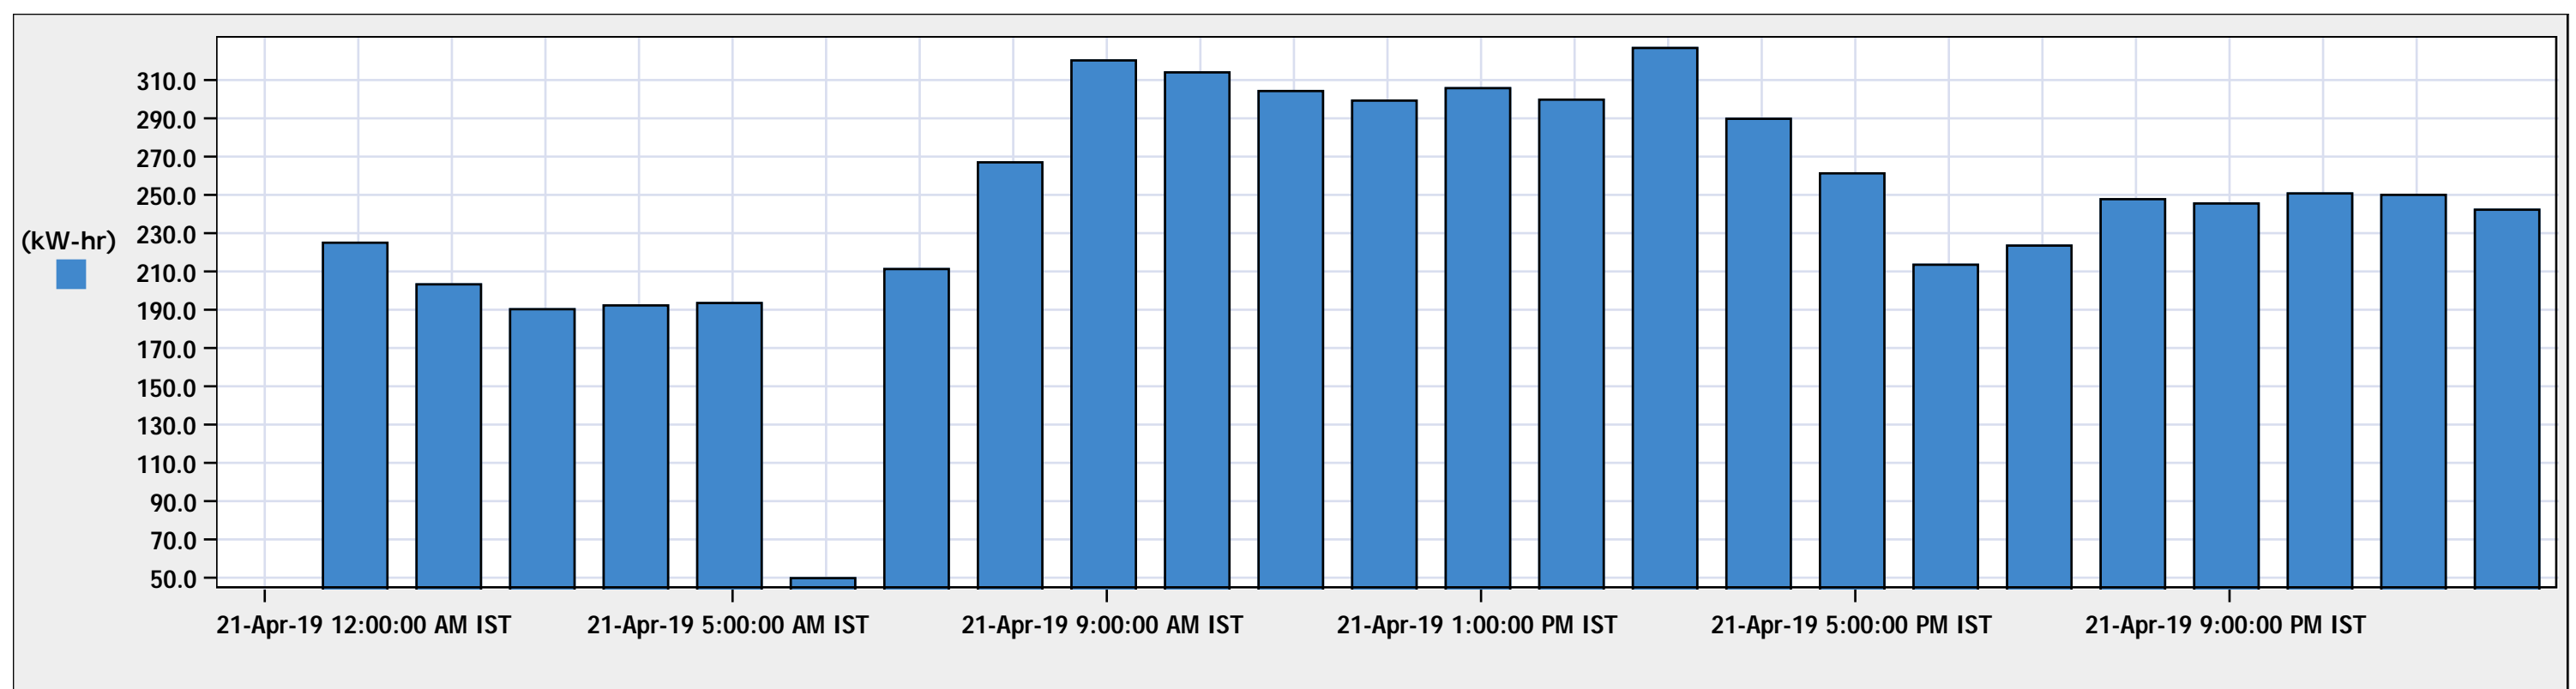

## Daily Energy Consumption - Main Meter

(Electricity Rate 7.50)

Display Name	Consumption (kW-hr)	Cost (INR)	Max (kW)	Min (kW)
Main Panel	6076.25	45571.88	408.24	92.45

## Submeters

Display Name	Cosumption (kW-hr)	Cost (INR)	Cosumption (%)	Max (kW)	Min (kW)
Chiller 1	1400.72	10505.39	23.05 %	73.45	21.55
Chiller 2	16.91	126.80	0.28 %	0.70	0.65
Chiller 3	16.66	124.92	0.27 %	0.70	0.65
HVAC Panel 1(SF)	235.86	1768.95	3.88 %	19.00	3.22
SUB Panel 1(HVAC P2)	1133.19	8498.91	18.65 %	50.48	46.52
HVAC Panel 3 (Terrace)	752.16	5641.17	12.38 %	60.15	8.10
Lift Panel(S)(Terrace)	64.05	480.38	1.05 %	12.82	1.08
Lift Panel(W)(Terrace)	0.00	0.00	0.00 %	0.00	0.00
Lift & Staircase Press Panel	18.09	135.67	0.30 %	1.74	0.00
Fire Fighting Panel	0.00	0.00	0.00 %	0.00	0.00
UPS Panel	178.56	1339.22	2.94 %	7.95	6.95
Inverter Panel(Basement)	200.33	1502.46	3.30 %	9.66	7.12
Ventilation Panel	13.50	101.25	0.22 %	1.34	0.00
Plumbing Panel	51.98	389.82	0.86 %	7.68	0.00
SMDB Guest Panel	480.00	3600.00	7.90 %	0.03	0.02
Common Area Panel(GF)	206.72	1550.39	3.40 %	12.30	6.25
Kitchen Panel(GF)	630.00	4725.00	10.37 %	0.05	0.01
Laundry Panel(SF)	501.78	3763.36	8.26 %	37.04	-3.20
Service Floor Panel	77.75	583.12	1.28 %	6.37	0.51
External Ltg for FFM	52.27	392.02	0.86 %	4.54	0.26
Ext. Ltg & Power Earthspace	0.16	1.17	0.00 %	1.34	0.10
250A Feeder(Spare)	0.00	0.00	0.00 %	0.00	0.00
400A Feeder(Spare)	0.00	0.00	0.00 %	0.00	0.00

## Monthly Energy Consumption - Main Meter

(Electricity Rate 7.50)

Display Name	Cosumption (kW-hr)	Cost (INR)	Max (kW)	Min (kW)
Main Panel	126828.25	951211.88	422.93	92.45

## Submeters

Display Name	Cosumption (kW-hr)	Cost (INR)	Cosumption (%)	Max (kW)	Min (kW)
Chiller 1	22639.91	169799.30	17.85 %	75.10	0.00
Chiller 2	6110.56	45829.22	4.82 %	73.00	0.00
Chiller 3	812.00	6090.00	0.64 %	69.20	0.00
HVAC Panel 1(SF)	4727.52	35456.37	3.73 %	22.48	0.96
SUB Panel 1(HVAC P2)	23011.06	172582.97	18.14 %	51.30	24.52
HVAC Panel 3 (Terrace)	16434.81	123261.09	12.96 %	81.30	4.80
Lift Panel(S)(Terrace)	1354.01	10155.06	1.07 %	21.92	1.08
Lift Panel(W)(Terrace)	0.00	0.00	0.00 %	0.00	0.00
Lift & Staircase Press Panel	394.18	2956.35	0.31 %	1.80	0.00
Fire Fighting Panel	0.46	3.45	0.00 %	0.00	0.00
UPS Panel	3804.88	28536.56	3.00 %	9.05	6.50
Inverter Panel(Basement)	4188.23	31411.70	3.30 %	10.62	6.80
Ventilation Panel	786.17	5896.27	0.62 %	6.88	0.00
Plumbing Panel	2287.57	17156.78	1.80 %	12.50	0.00
SMDB Guest Panel	10250.00	76875.00	8.08 %	0.04	0.01
Common Area Panel(GF)	4234.36	31757.70	3.34 %	18.65	4.80
Kitchen Panel(GF)	13090.00	98175.00	10.32 %	0.07	0.00
Laundry Panel(SF)	10553.62	79152.19	8.32 %	49.60	-5.28
Service Floor Panel	1637.83	12283.71	1.29 %	7.90	0.35
External Ltg for FFM	866.52	6498.93	0.68 %	7.62	0.14
Ext. Ltg & Power Earthspace	3.40	25.50	0.00 %	1.36	0.00
250A Feeder(Spare)	0.00	0.00	0.00 %	0.00	0.00
400A Feeder(Spare)	0.00	0.00	0.00 %	0.00	0.00

22-Apr-19 6:00 AM IST